
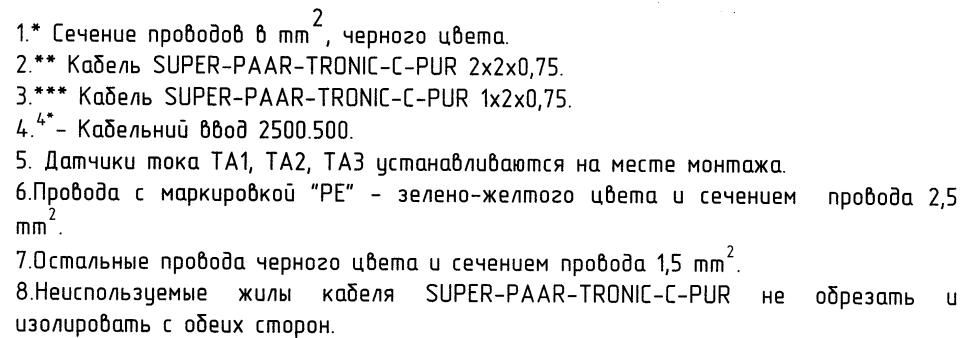
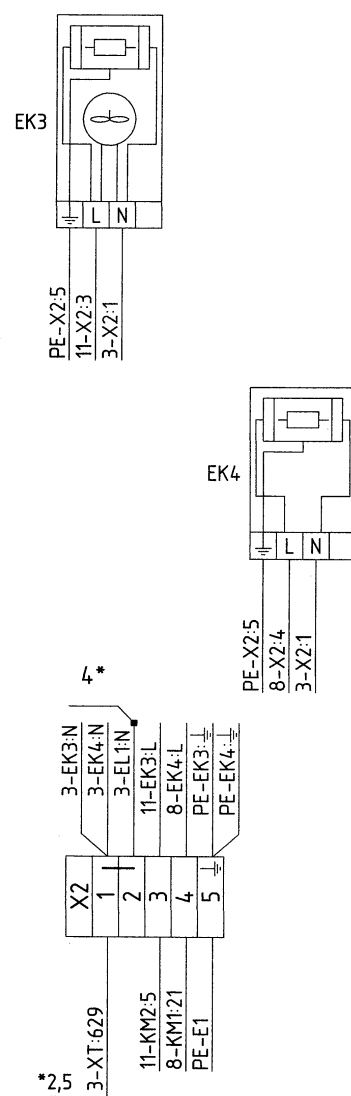
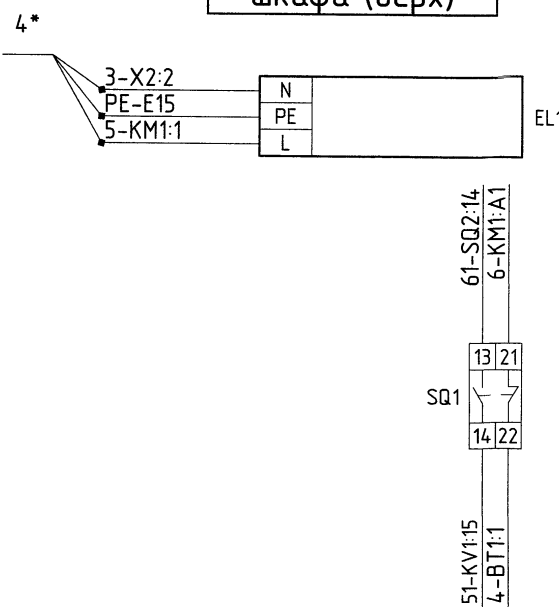





Стенка левая

[illegible]



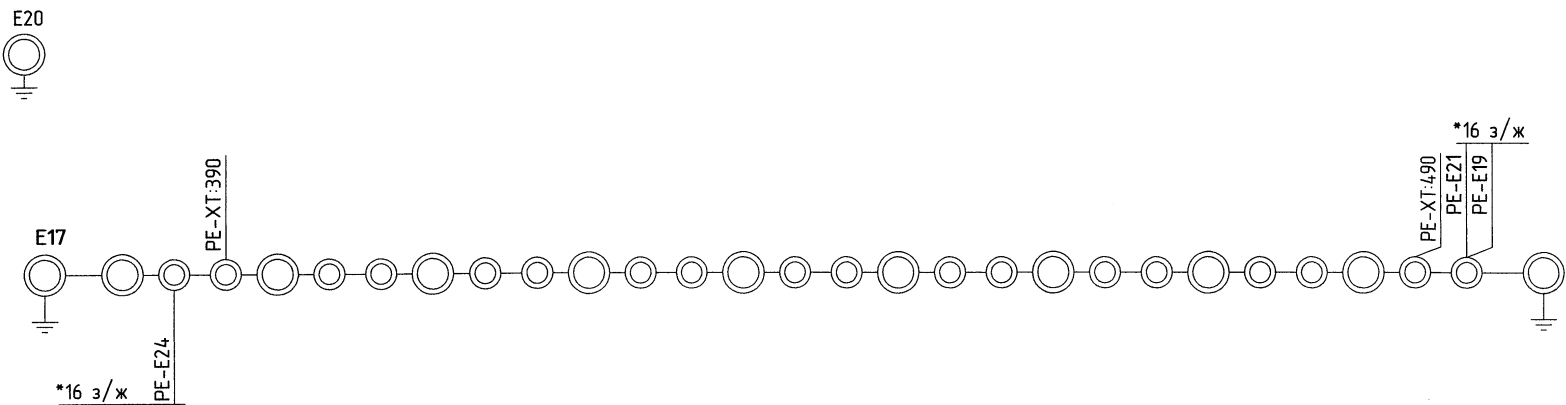


В цепи Заказчика	301	к приборам
	302	
	303	
	304	
	305	
	306	
	307	
	308	
	309	
	310	
Резерв	311	301-KL1-11
	312	302-KL1-14
	313	303-KL1-21
	314	304-KL1-24
	315	305-KL1-31
	316	306-KL1-34
	317	307-KL2-11
	318	308-KL2-14
	319	309-KL2-21
	320	310-KL2-24
В цепи Заказчика	321	311-KL2-31
	322	312-KL2-34
	323	313-KL3-11
	324	314-KL3-14
	325	315-KL3-21
	326	316-KL3-24
	327	317-KL3-31
	328	318-KL3-34
	329	319-KL4-11
	330	320-KL4-14
Резерв	331	321-KL4-21
	332	322-KL4-24
	333	323-KL4-31
	334	324-KL4-34
	335	325-KL5-11
	336	326-KL5-14
	337	327-KL5-21
	338	328-KL5-24
	339	329-KL5-31
	340	330-KL5-34
В цепи Заказчика	341	
	342	
	343	
	344	
	345	
	346	
	347	
	348	
	349	
	350	
Резерв	351	
	352	
	353	
	354	
	355	
	356	
	357	
	358	
	359	
	360	
В цепи Заказчика	361	
	362	
	363	
	364	
	365	
	366	
	367	
	368	
	369	
	370	
Резерв	371	
	372	
	373	
	374	
	375	
	376	
	377	
	378	
	379	
	380	
В цепи Заказчика	381	
	382	
	383	
	384	
	385	
	386	
	387	
	388	
	389	
	390	


Панель центральная

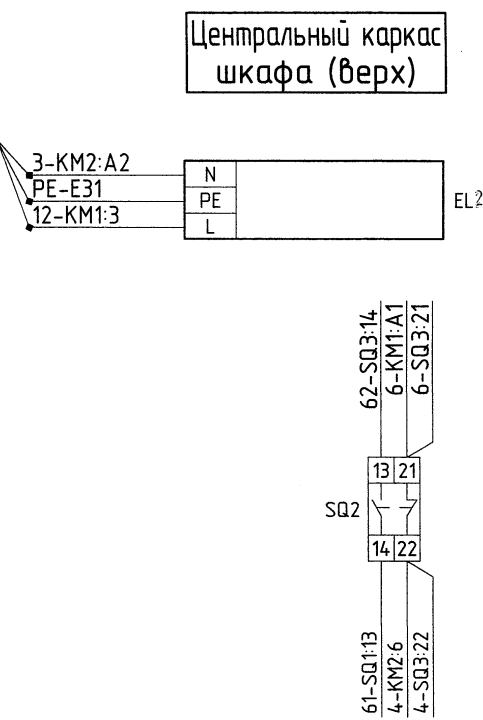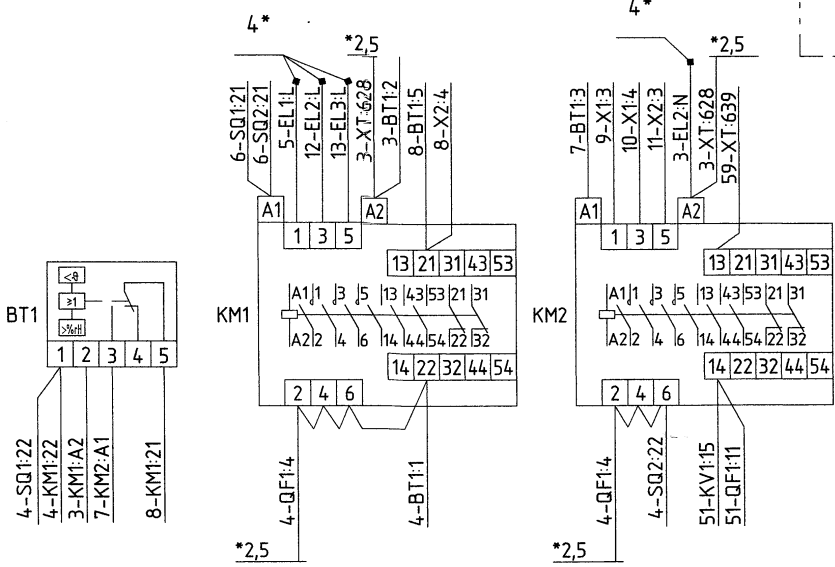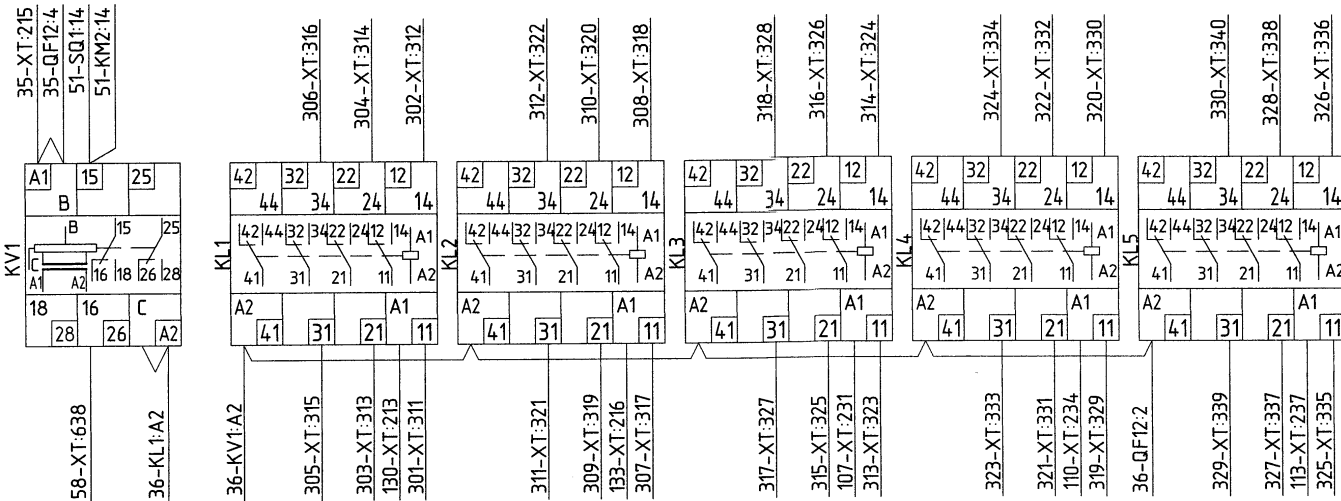



Панель правая

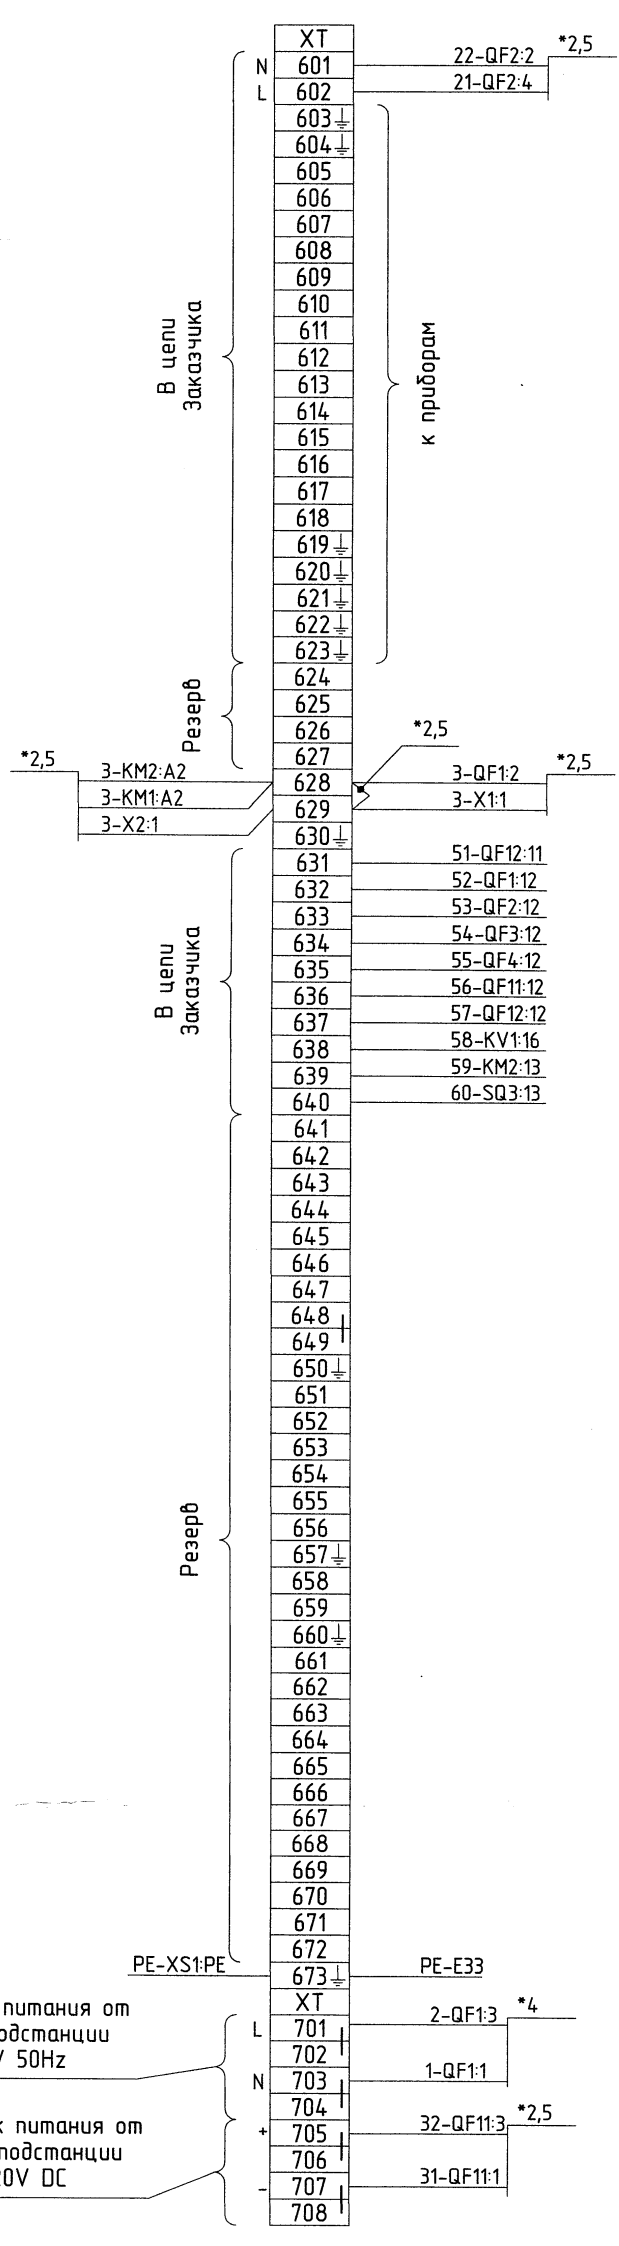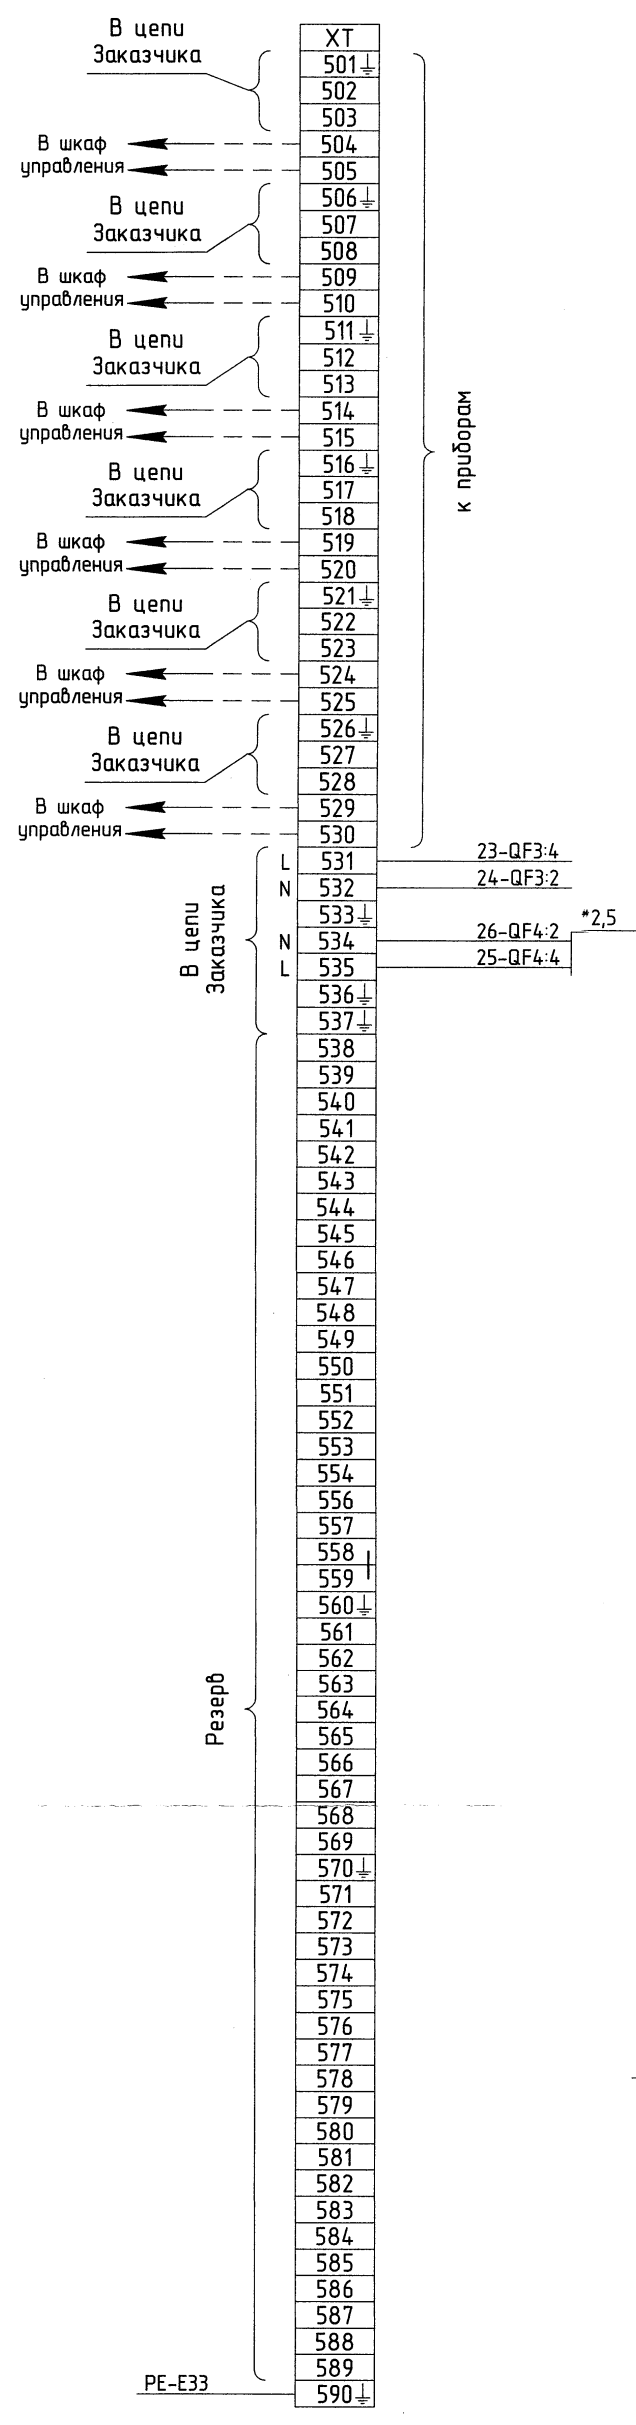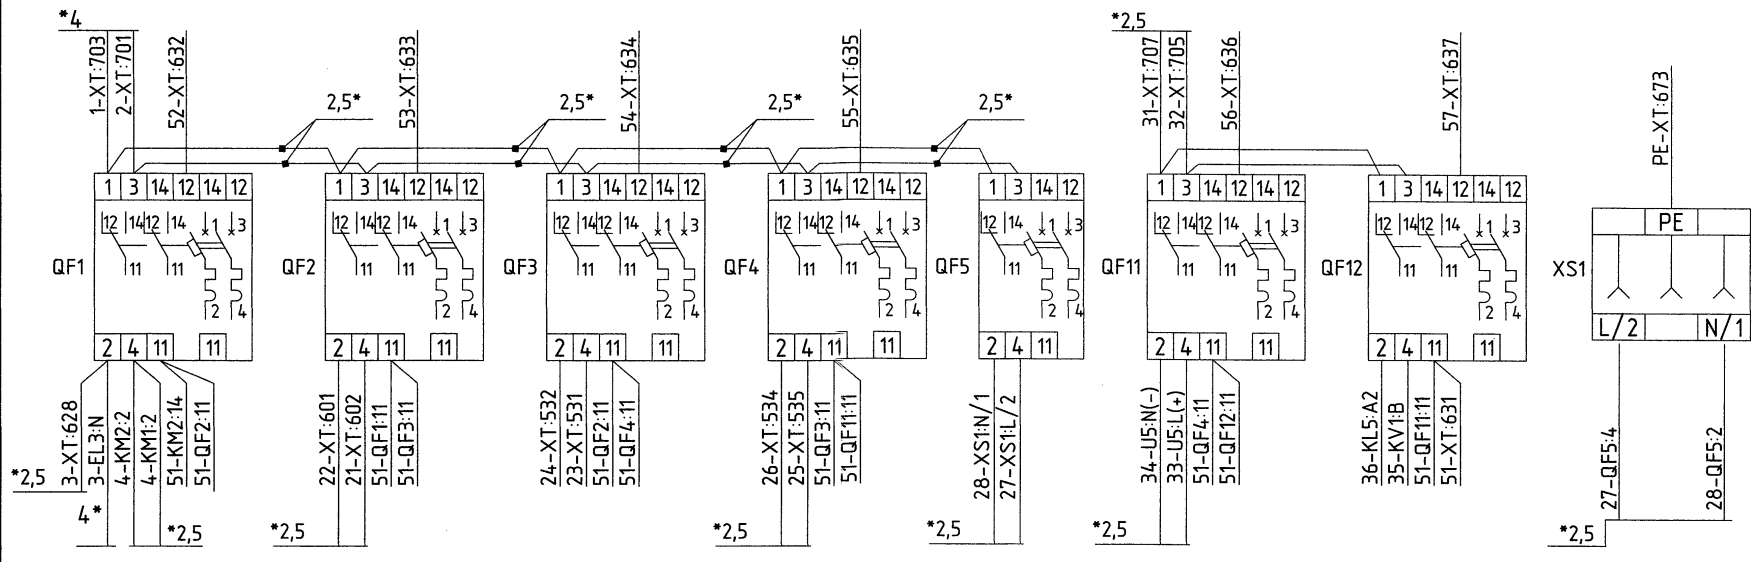

Правый каркас шкафа (верх)

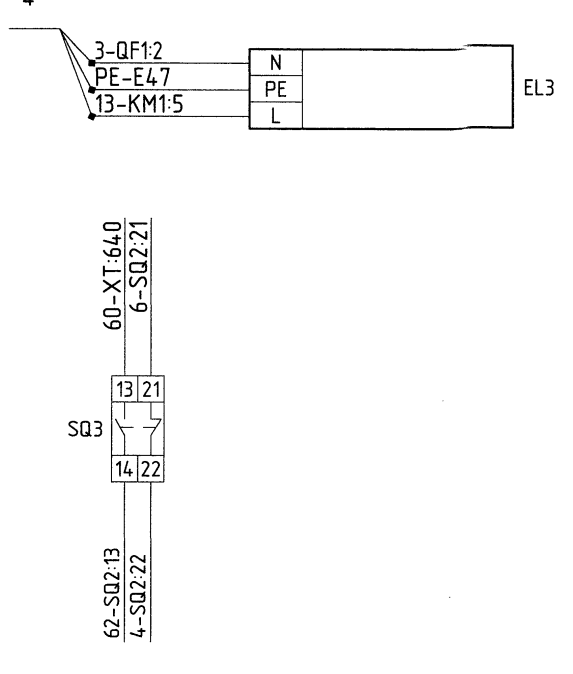

Правая стенка

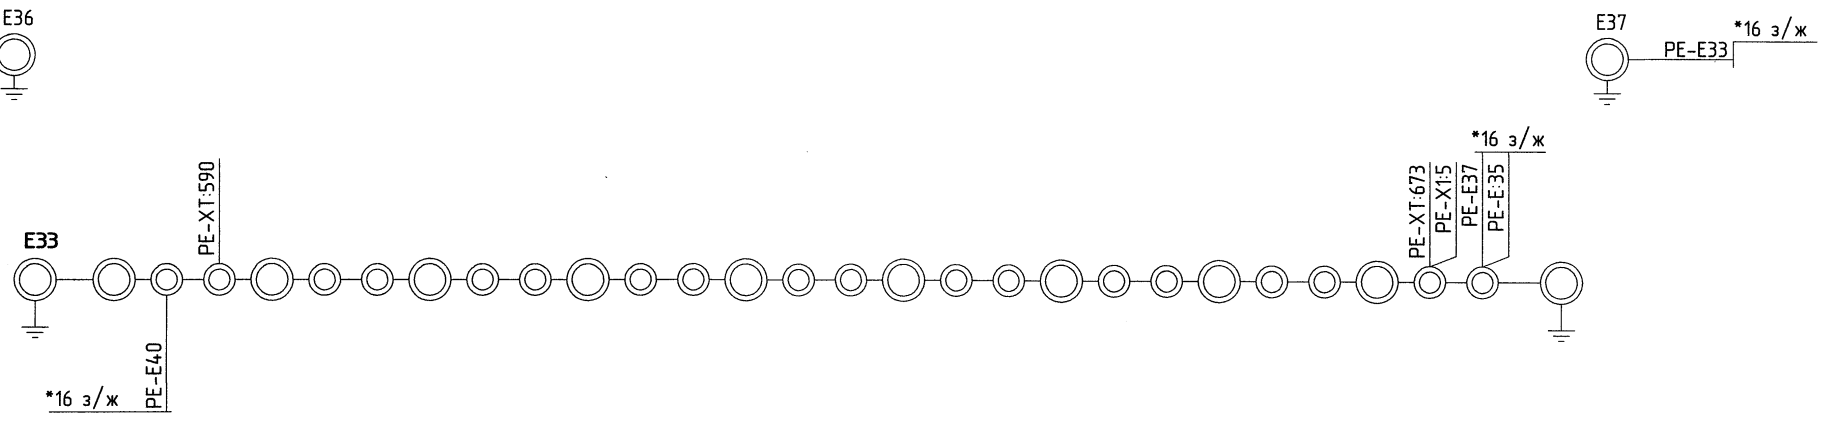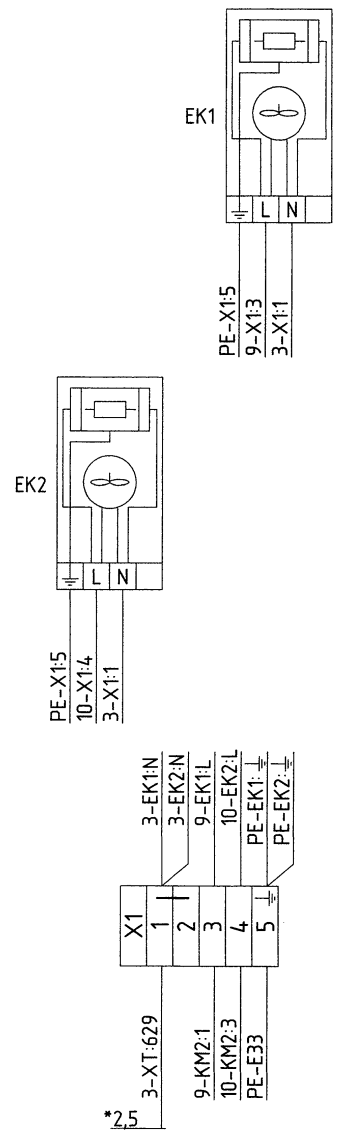

Изд. № 001/1990 Подп. и дата 07.03.137

Схема заземления шкафа

Все подключения каблом сечением 16 мм², зелено-желтого цвета
и маркировать биркой "РЕ" с обеих концов провода.

